

riscaldamento

07/05/2011

heating

Tipo motore : 100L-2


V Nom. [V] : 400

Frequenza [Hz] : 50


P Nom.[KW] :

Giri [min⁻¹] :

File Prova : C:\Elektro\Prove\Trifase\100\ 100L-2 IE2 B3 10121265 07MAG2011.TXT



motive

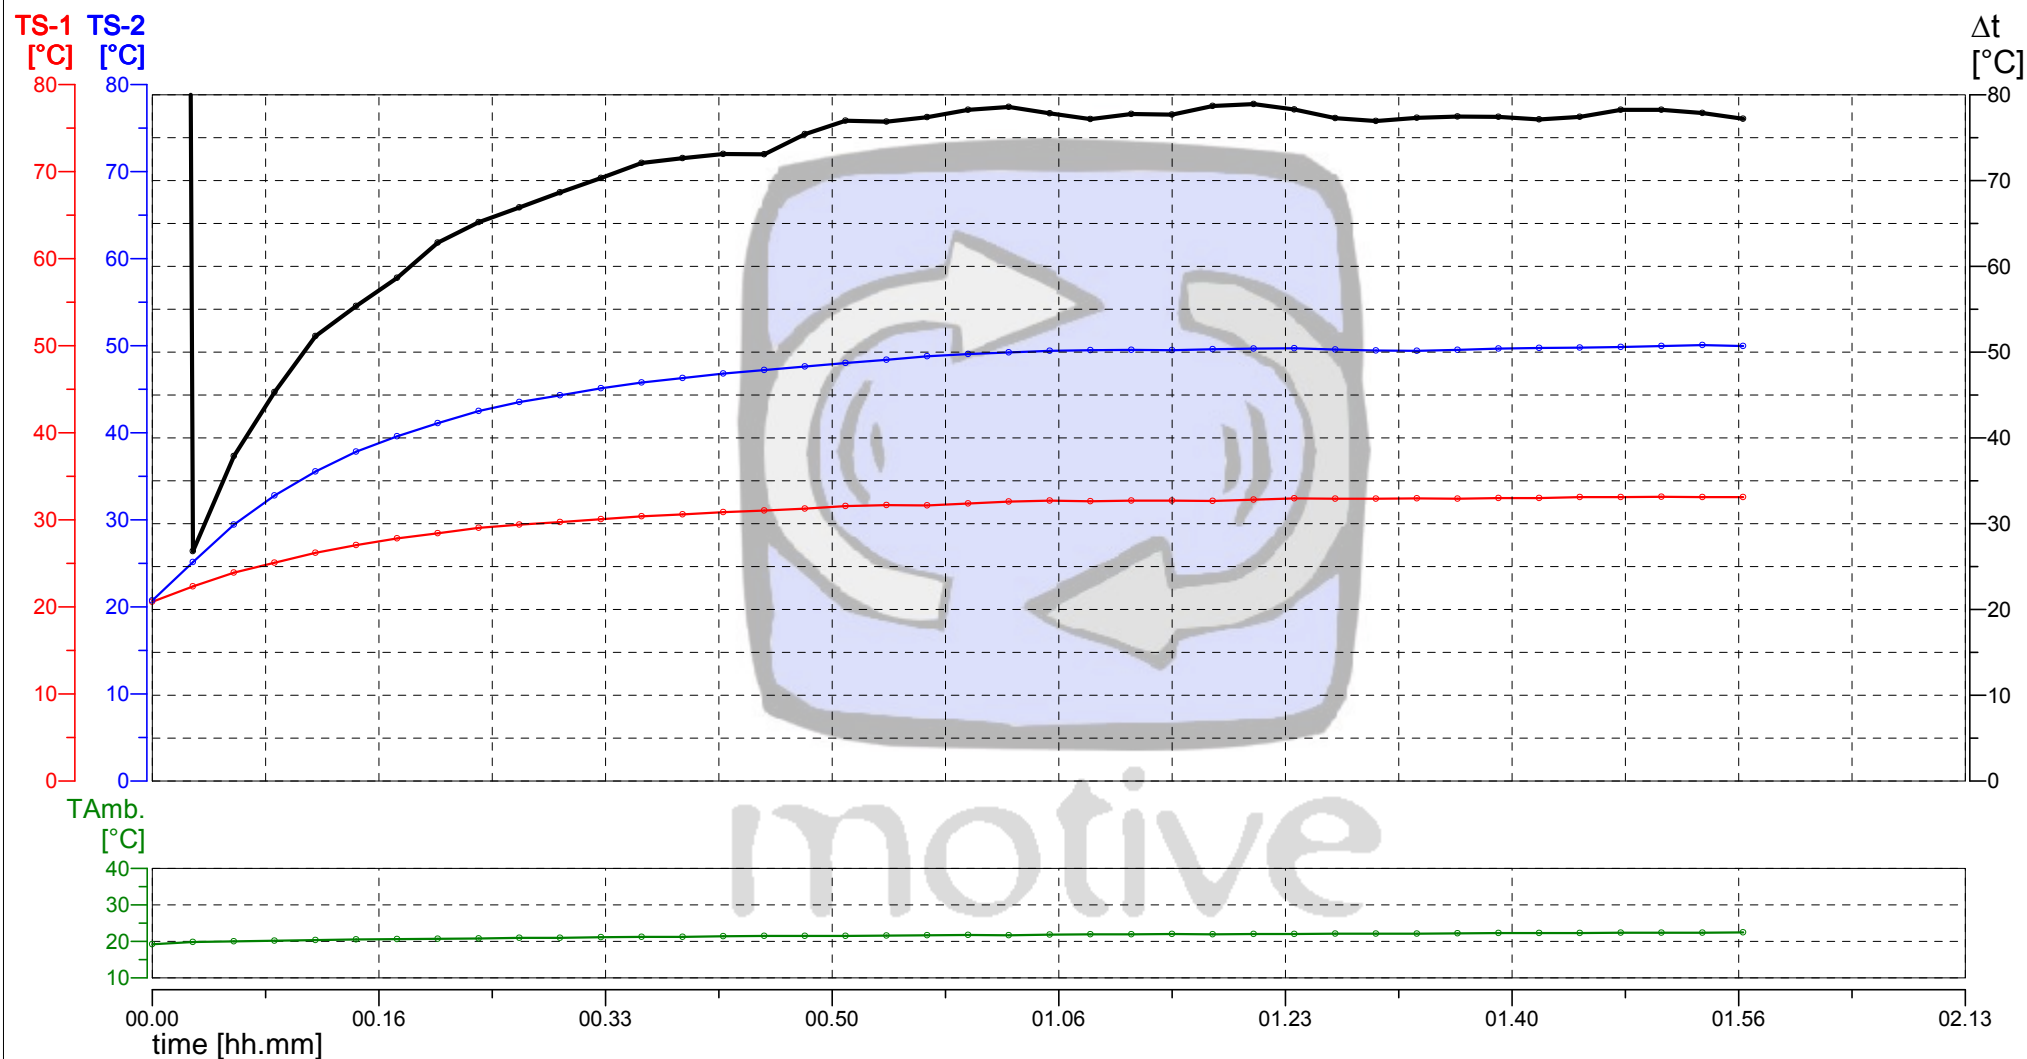

Note : Note: