


riscaldamento

heating

22/06/2009



motive

Tipo motore : 100L-2


V Nom. [V] : 400

Frequenza [Hz] : 50

P Nom.[KW] : 3

Giri [min??] : 2860

File Prova : C:\Elektro\Prove\Trifase\100\ 100L-2 B3 EFF1 2009,5 22GIU09.TXT

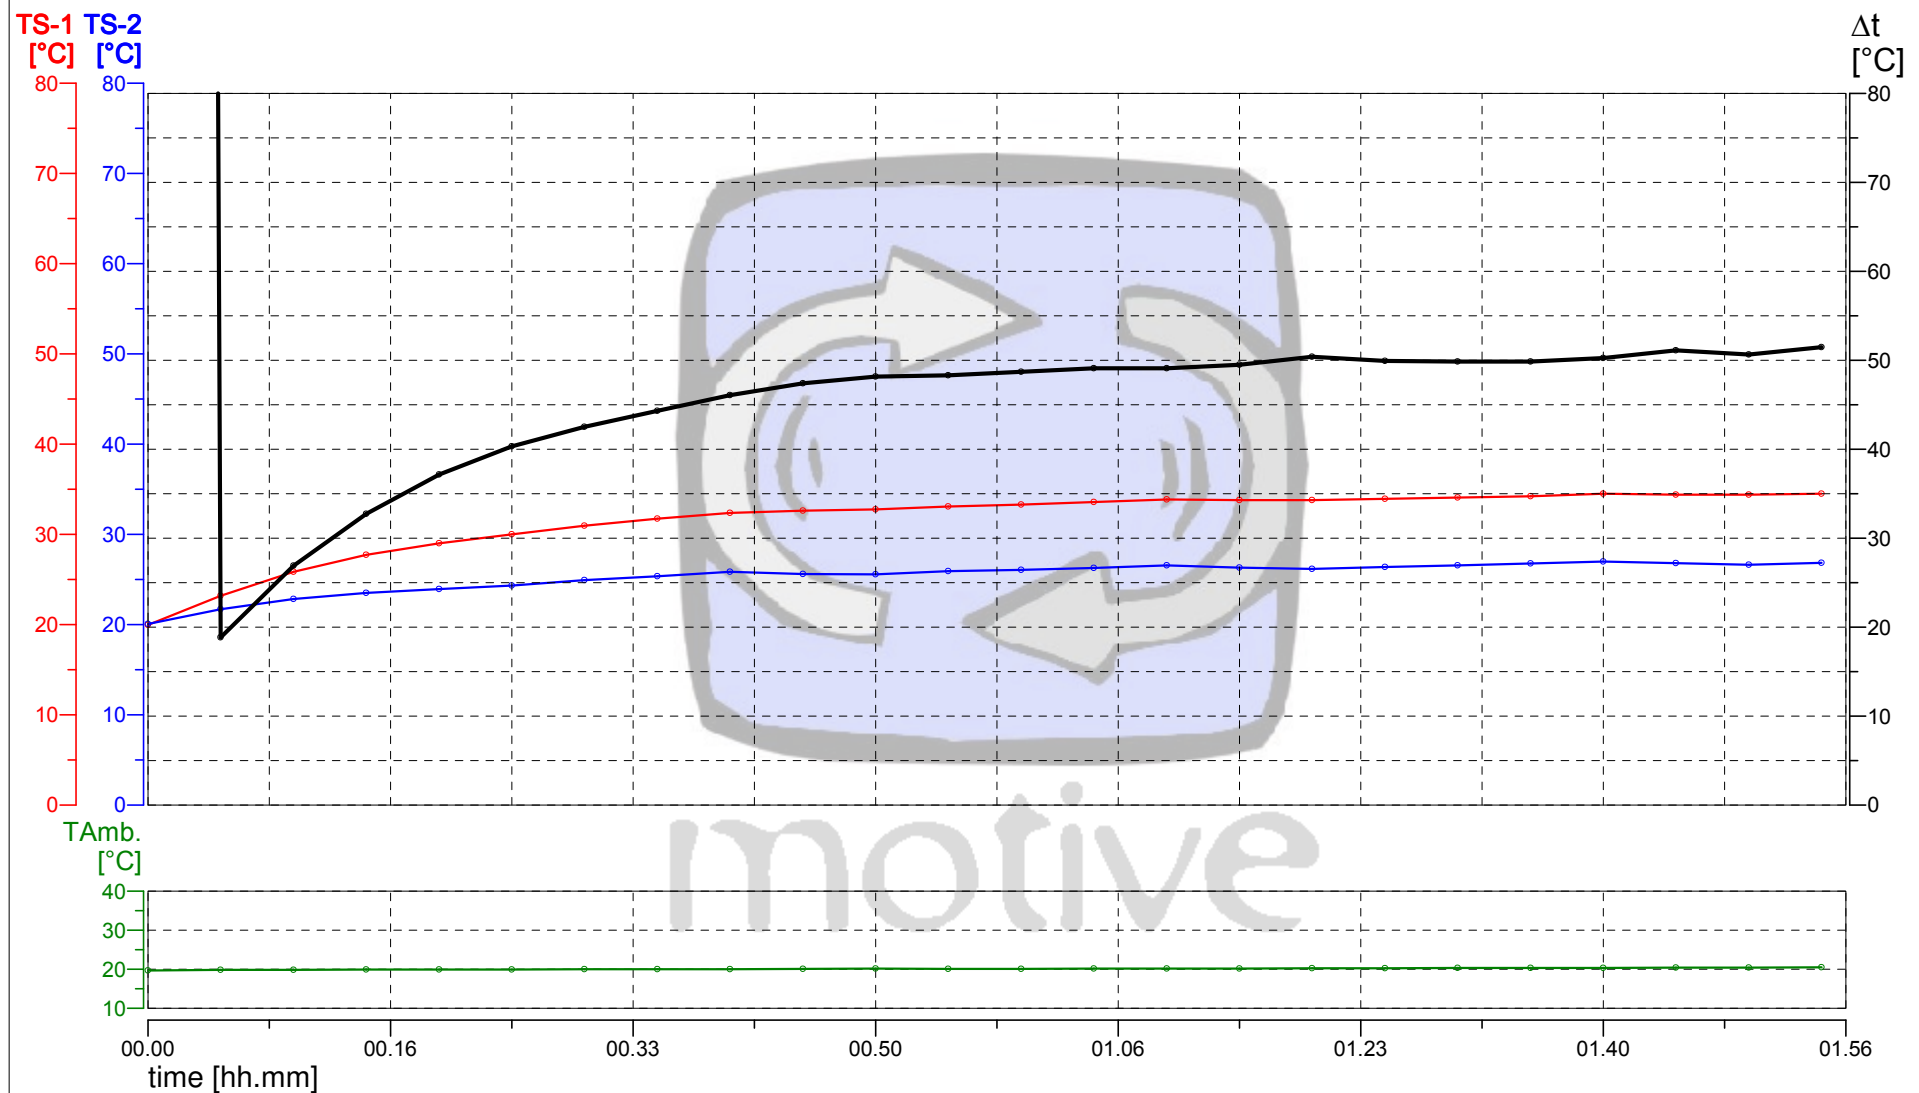

Note : PROVA MOTORE (Fabio) EFF1