


riscaldamento

06/06/2011

heating



motive

Tipo motore : 100L-6


V Nom. [V] : 400

Frequenza [Hz] : 50

P Nom.[KW] : 1,5

Giri [min⁻¹] :

File Prova : C:\Elektro\Prove\Trifase\100\ 100L-6 B3 090410074 IE3 06GIU2011.TXT

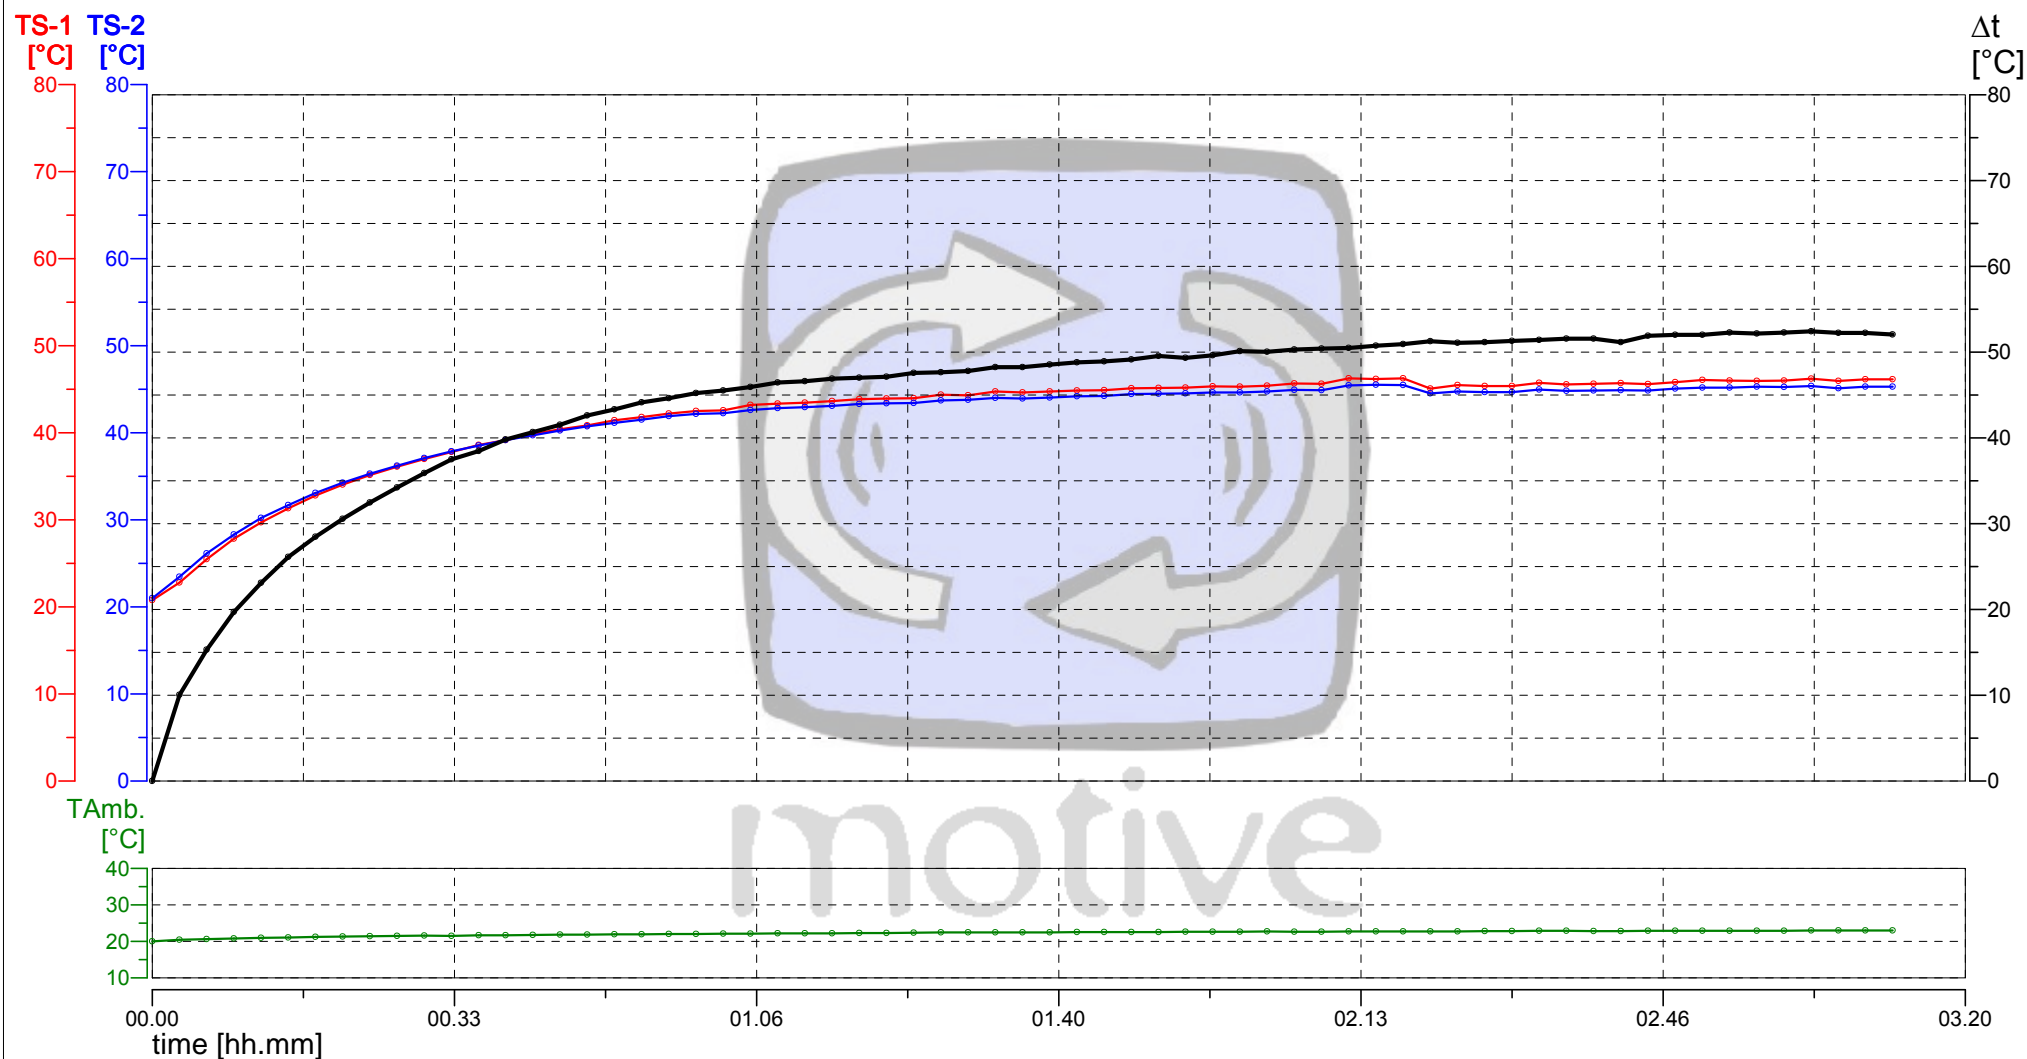

Note : Note: MOTORE IE3