

riscaldamento

28/04/2011

heating

Tipo motore : 100LB-4


V Nom. [V] : 400

Frequenza [Hz] : 50


P Nom.[KW] : 3

Giri [min⁻¹] :

File Prova : C:\Elektro\Prove\Trifase\100\ 100LB-4 B3 11011843T 28APR2011 IE2.TXT



motive

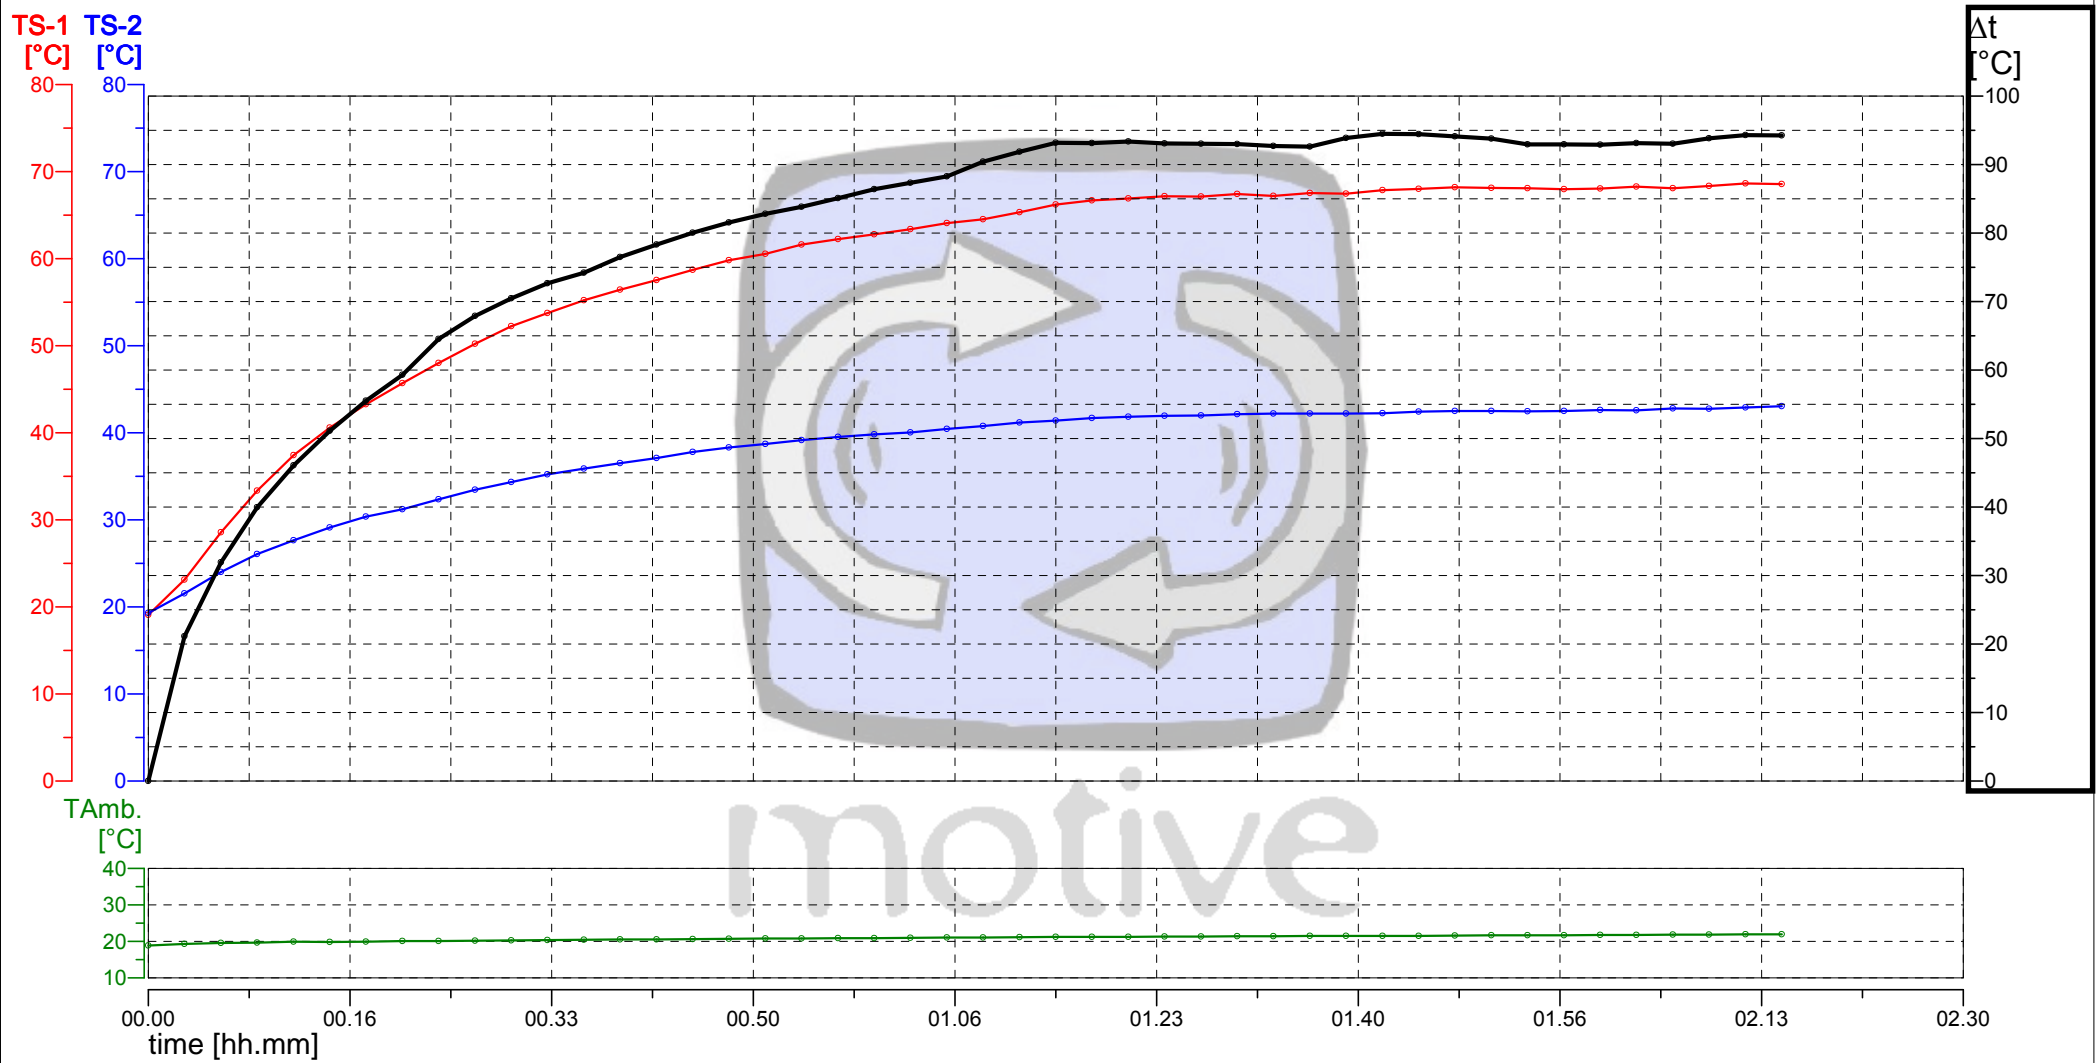

Note : Note: