


riscaldamento

heating

19/06/2009



motive

Tipo motore : 90L-4 B3


V Nom. [V] : 400

Frequenza [Hz] : 50

P Nom.[KW] : 1,5

Giri [min.⁻¹] : 1390

File Prova : C:\Elektro\Prove\Trifase\90\ 90L-4 B3 EFF1 2009,5 19GIU09.TXT

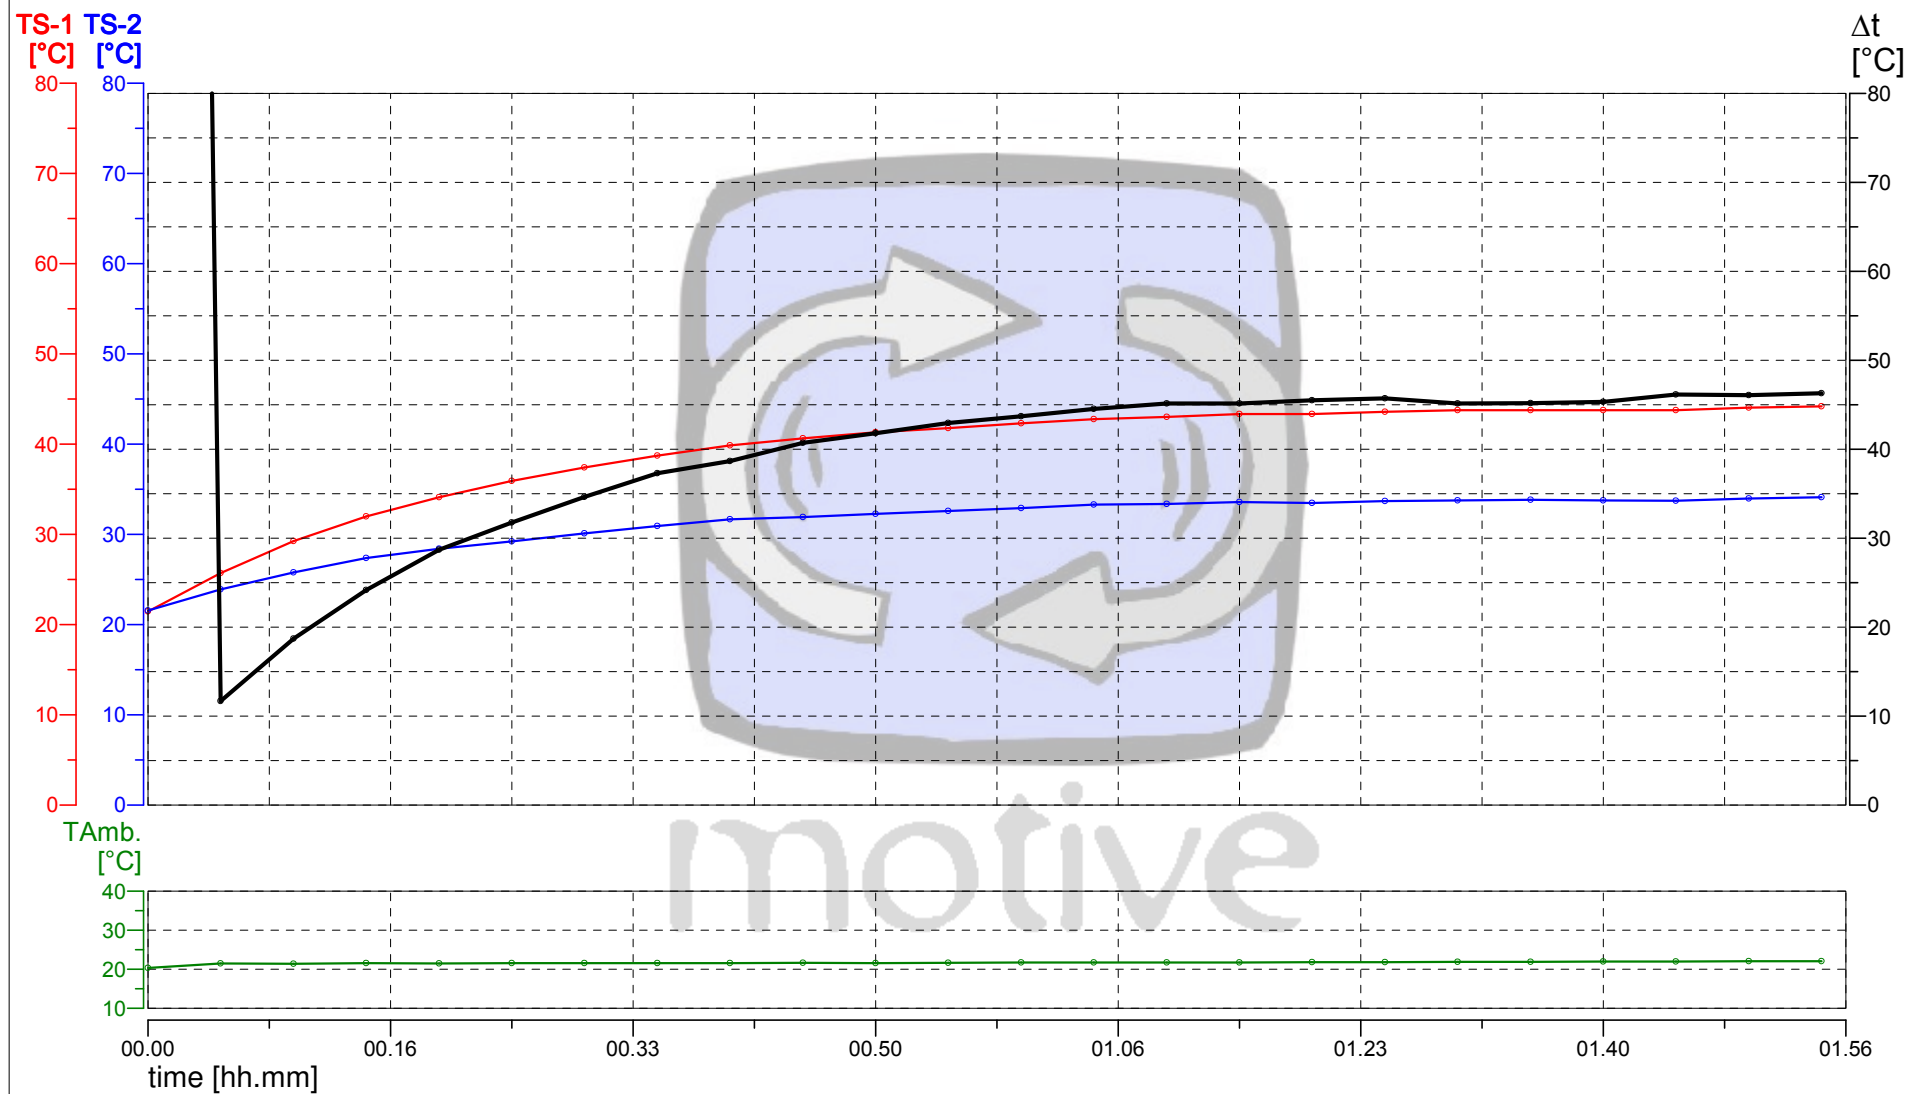

Note : PROVA MOTORE (Fabio)