


# RENDIMENTO

08/06/2011

*EFFICIENCY*



motive

Tipo motore : 90S-6


V Nom. [V] : 400

Frequenza [Hz] : 50

P Nom.[KW] : 0,75

Giri [min<sup>-1</sup>] :

File Prova : C:\Elektro\Prove\Trifase\90\ 90S-6 B3 11015260 IE3 08GIU2011.TXT

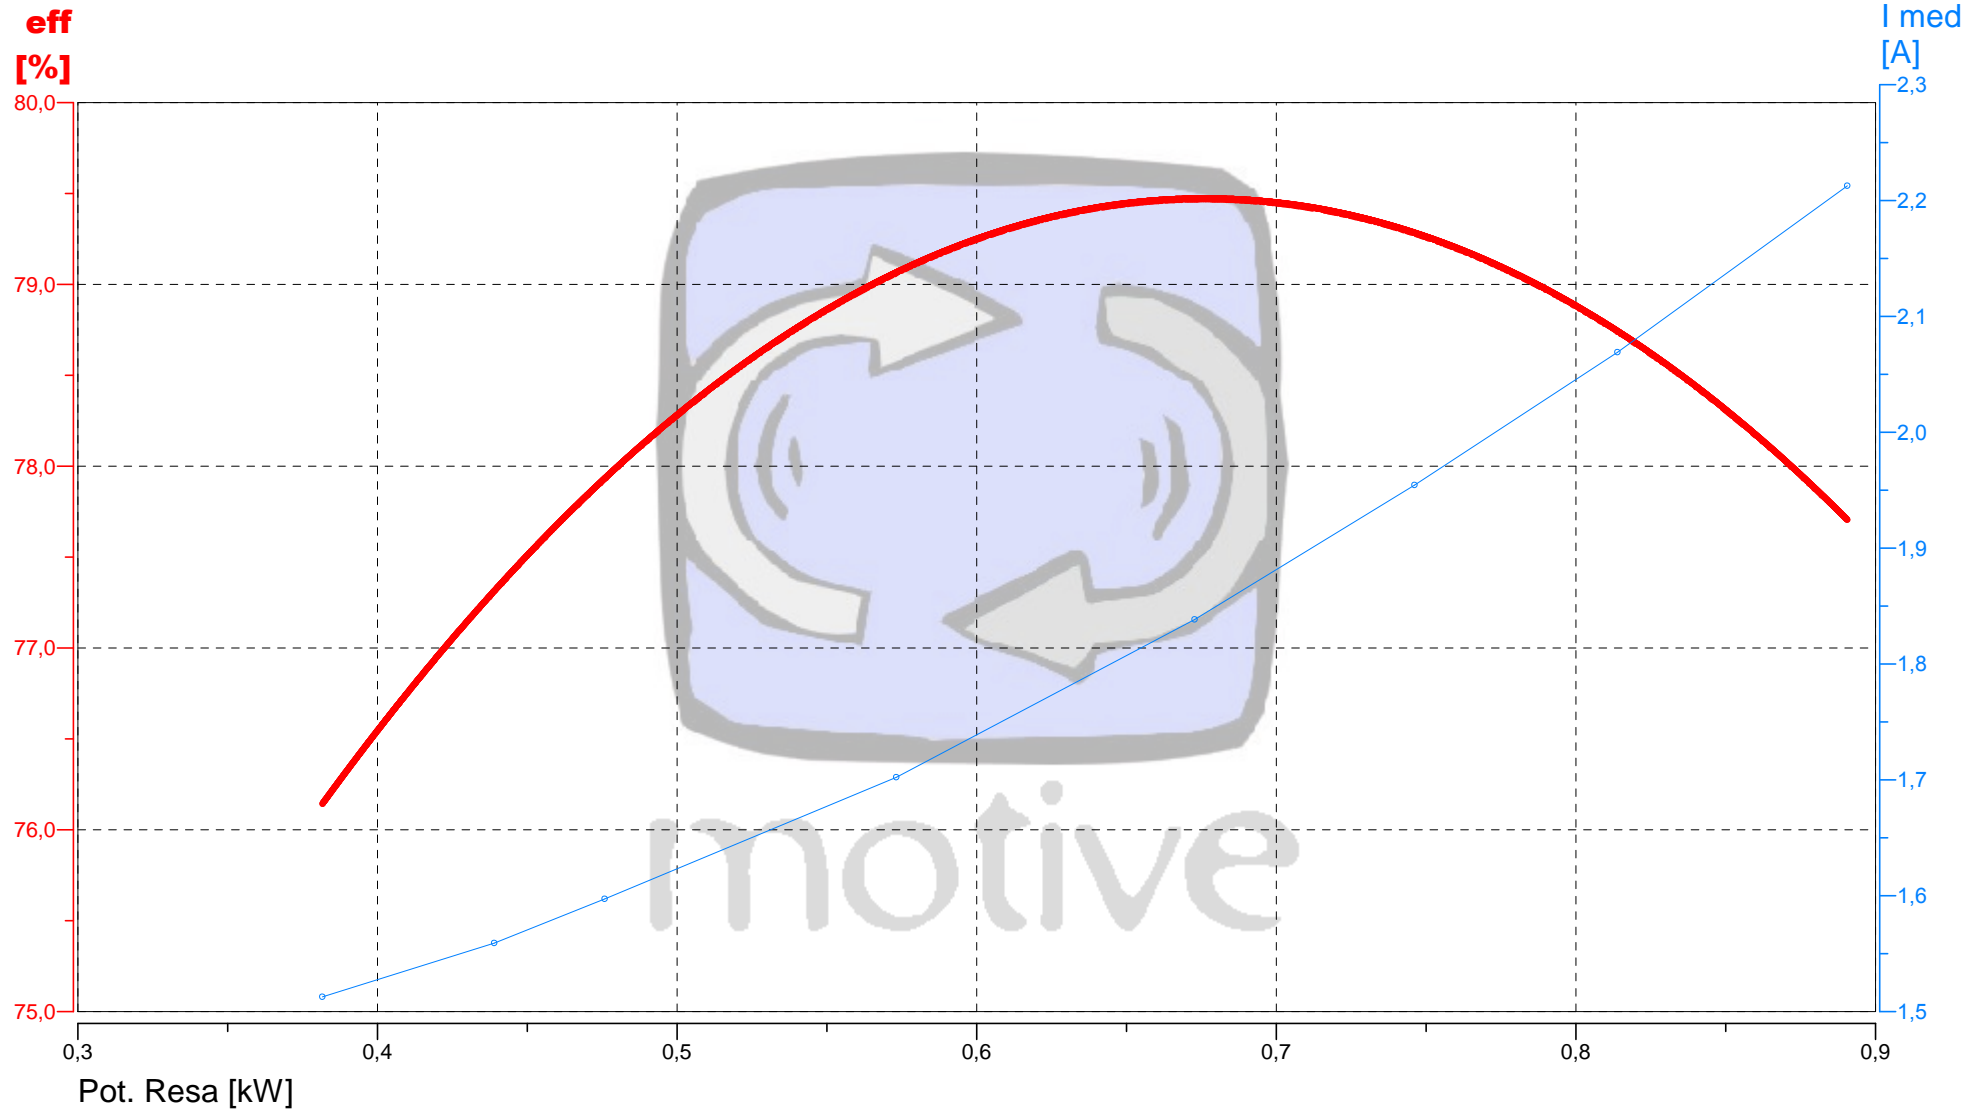

Note : Note: MOTORE IE3