

# riscaldamento

23/02/2009

heating

Tipo motore : 100LA-2


V Nom. [V] : 400

Frequenza [Hz] : 50


P Nom.[KW] : 0,75

Giri [min.<sup>-1</sup>] : 715

File Prova : C:\Elektro\Prove\Trifase\100\ 100LA-8 B3 0810G02031 23FEB09.TXT



motive

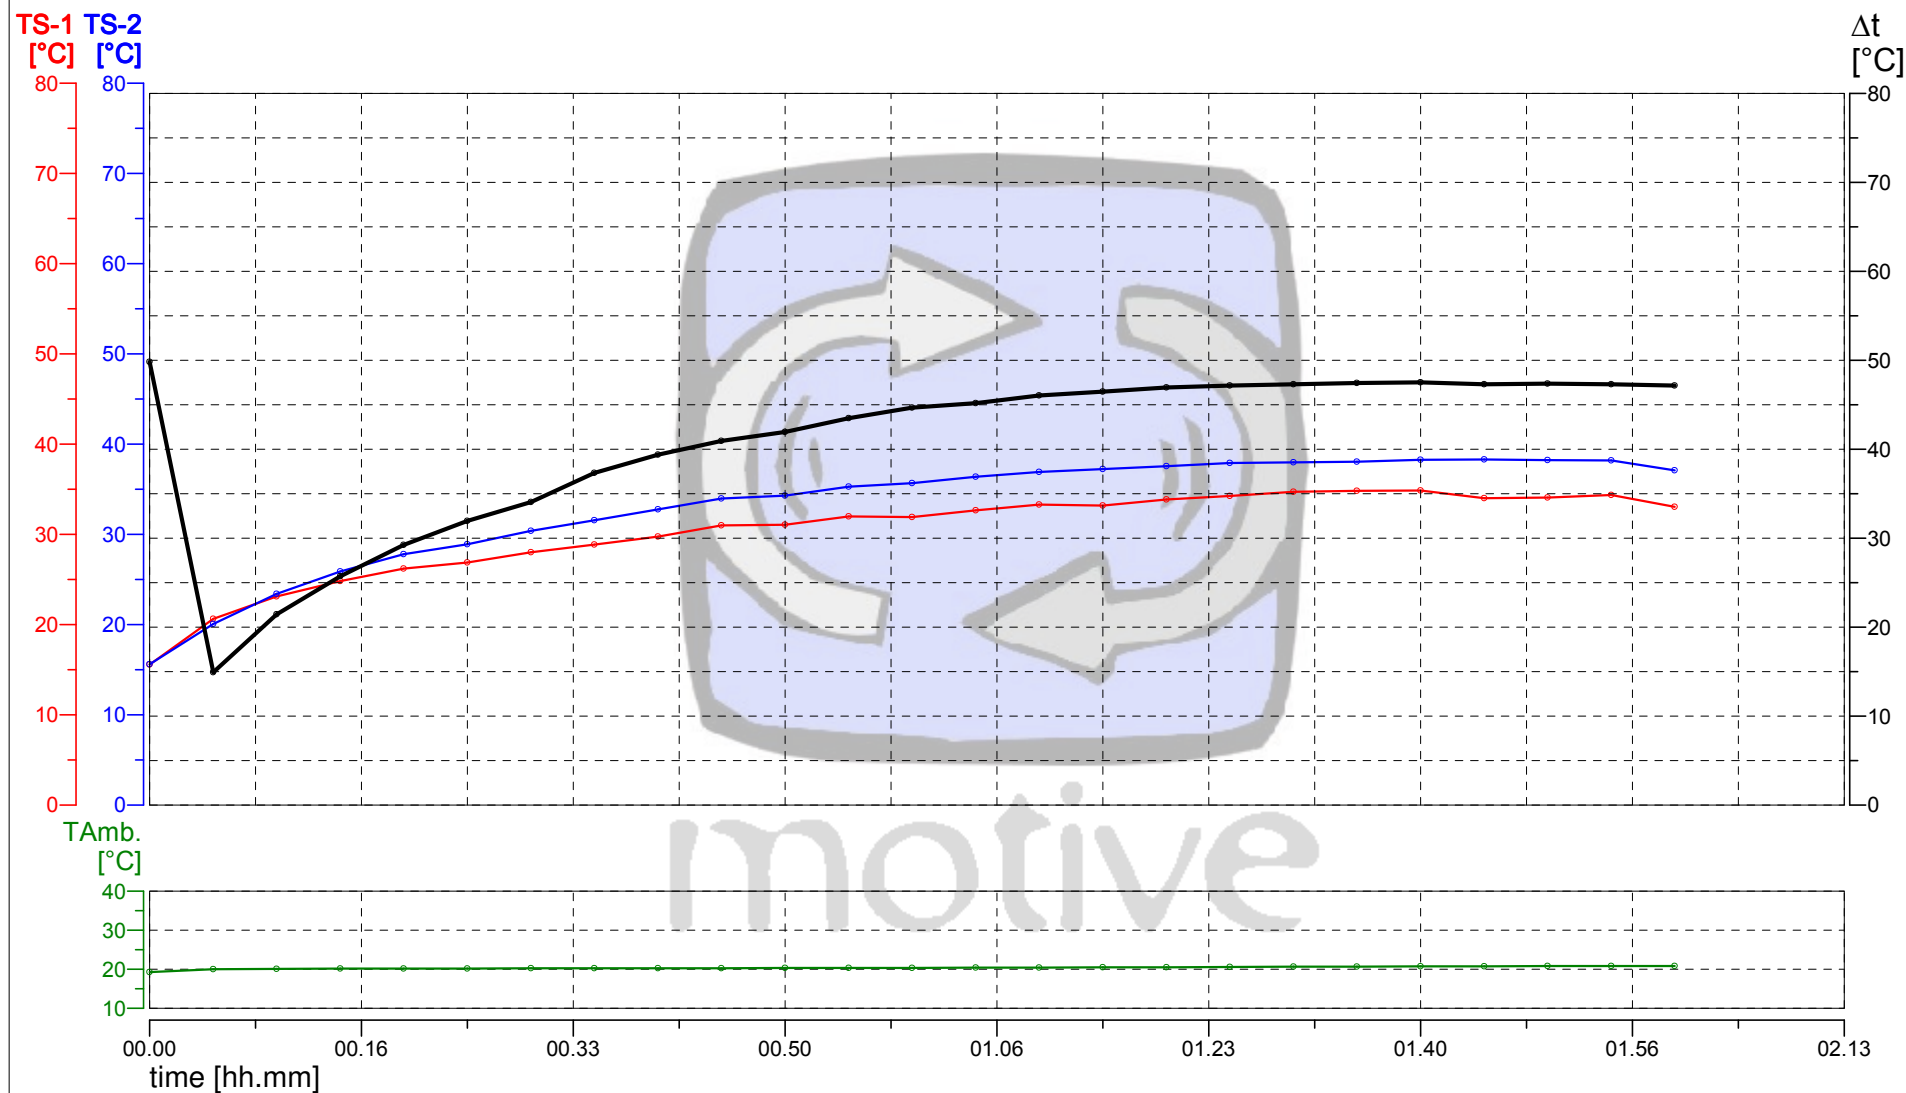

Note : Note: PROVA MOTORE (Giacomo)